


8 7 6 5 4 3 2 1

NOTES	
RECOMMENDED MINIMUM CLEARANCES	<ul style="list-style-type: none"> * FRONT:- 1000 mm. * REAR:- 1000 mm. * TOP:- 500 mm. * SIDE:- 1000 mm. * [MULTIPLE PANELS MAY BE STACKED SIDE BY SIDE]
RECOMMENDED OPERATING CONDITION	<ul style="list-style-type: none"> * AMBIENT TEMP:-45 deg.C max. * MAX.HUMIDITY:- 95% RH NON CONDENSING
COLOUR	<ul style="list-style-type: none"> * OUTSIDE :- RAL-7032 * INSIDE :-RAL-7032 * METER PLATE :-BLACK
MATL.	<ul style="list-style-type: none"> * CRCA STEEL SHEET * FRAME:- 2.0 mm,THK. * DOORS:- 2.00 & 1.6 mm,THK.
DEGREE OF PROTECTION :-	IP-41
INPUT TERMINAL HEIGHT OF GND :-	MINI.350 mm.

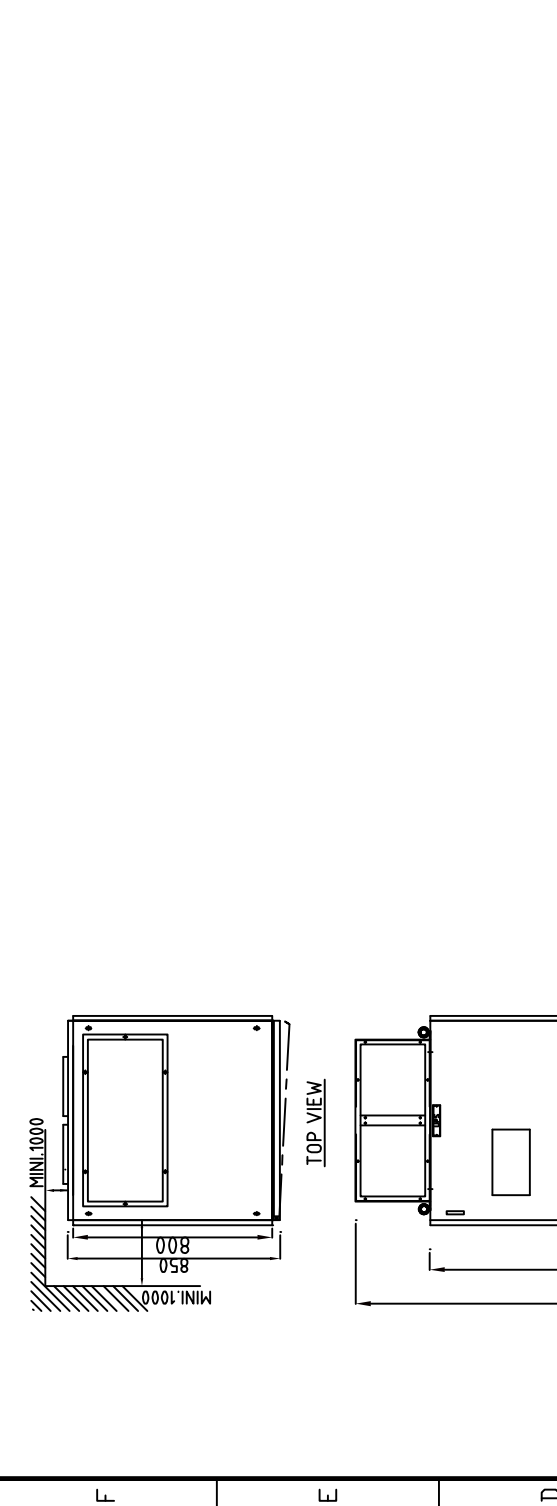

APPLICABLE TO	
→	40KVA UPS
→	40KVA,50KVA & 60KVA SCVVS PANEL
→	40KVA SSVS PANEL

REV.	DESCRIPTION	DATE	APPRD.	DRN.	APPRD.	TITLE:-
				Jitu	Ajit	CONFIG OVER VIEW
			06.11.06	06.11.06		
				SHEET :- 01 OF 01		DRG.NO. 065C012100
						REV. 0

HI-REL ELECTRONICS PVT.LTD.
 UNIT-2,UPS & POWER CONDITIONING DIVISION
 ALL DIMENSIONS IN M.M. [INTS.]
 DIR. REF :-ENGG-2/A-061114