


1 2 3 4 5 6 7 8

NOTES	
RECOMMENDED MINIMUM CLEARANCES	<ul style="list-style-type: none"> <li>* FRONT:- 1000 mm.</li> <li>* REAR:- 1000 mm.</li> <li>* TOP:- 500 mm.</li> <li>* SIDE:- 1000 mm.</li> <li>* [MULTIPLE PANELS MAY BE STACKED SIDE BY SIDE]</li> </ul>
RECOMMENDED OPERATING CONDITION	<ul style="list-style-type: none"> <li>* AMBIENT TEMP:-45 deg.C max.</li> <li>* MAX.HUMIDITY:- 95% RH NON CONDENSING</li> </ul>
COLOUR UPS.	<ul style="list-style-type: none"> <li>* OUTSIDE :- RAL-7032</li> <li>* INSIDE :-RAL-7032</li> <li>* METER PLATE :-BLACK</li> </ul>
MATL.	<ul style="list-style-type: none"> <li>* CRCA STEEL SHEET</li> <li>* FRAME:- 2.0 mm,THK.</li> <li>* DOORS:- 2.00 &amp; 1.6 mm,THK.</li> </ul>
DEGREE OF PROTECTION :- IP-41	
INPUT TERMINAL HEIGHT OF GND :- MINI.350 mm.	

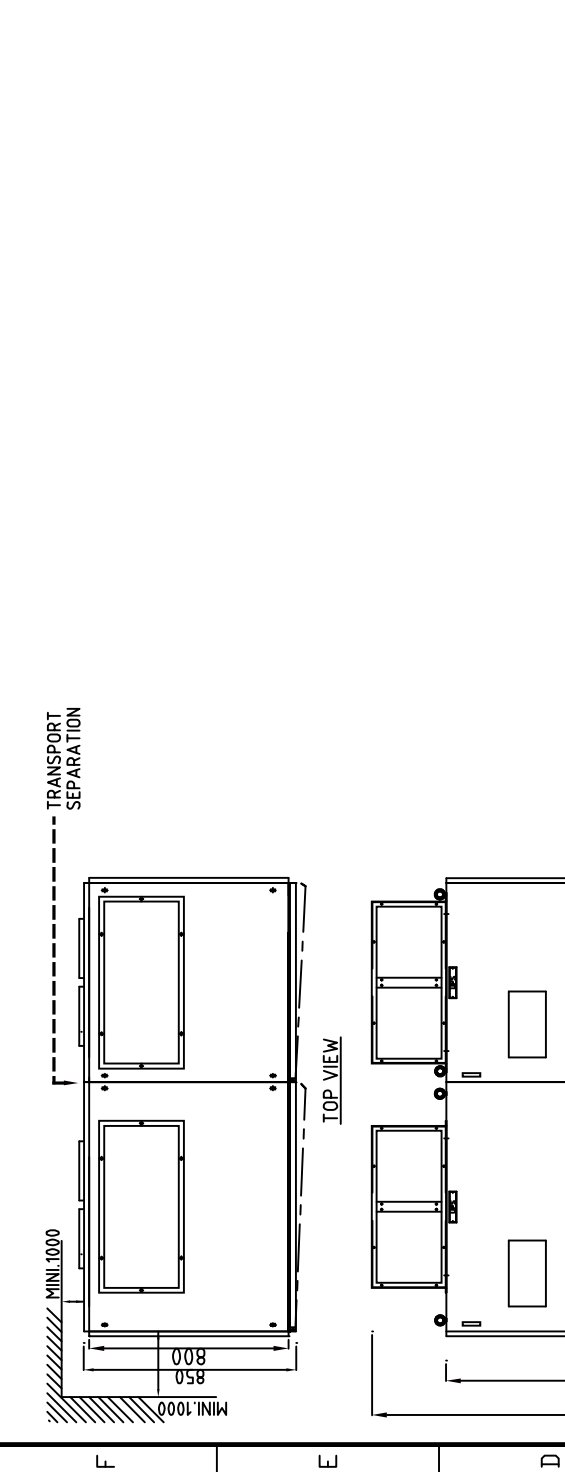

APPLICABLE TO	
→ 60,75KVA WITH IP X-MER	

REV.	DESCRIPTION	DATE	APPRD.	DRN.	APPRD.	TITLE:-
				Jitu	Ajit	<b>CONFIG OVER VIEW</b>
			24.05.07	24.05.07	24.05.07	
						DRG.NO. <b>065CO12100</b>
						REV. 0

**HI-REL ELECTRONICS PVT.LTD.**

UNIT-2,UPS & POWER CONDITIONING DIVISION

ALL DIMENSIONS IN M.M. [N.T.S.]

DIR. REF :-ENGG-2/A-061114

REV. 0

DRG.NO. **065CO12100**

SHEET :- 01 OF 01

APPROD. [Signature]

DATE [Date]

DRN. [Name]

APPRD. [Name]

TITLE:- **CONFIG OVER VIEW**

REV. RECORD